

## DIN W72×H36mm, W96×H48mm, Digital Multi Panel Meter

### ■ Features


- Various input/output (default: indicator)
  - Input: DC voltage, DC current, AC voltage, AC current
  - Output: RS485 communication output, Low speed serial output, transmission (DC4-20mA) output, BCD dynamic output, NPN/PNP open collector output, relay output
- Maximum allowed input : 500VDC, 500VAC, DC5A, AC5A
- Display range: -1999 to 9999
- High/low-limit display scale function
- AC frequency measurement (range: 0.1 to 9999Hz)
- Various functions: Monitoring peak display value function, display cycle delay function, zero adjustment function, high display correction function, transmission (DC4-20mA) output scale function etc.
- Power supply: 12-24VDC, 100-240VAC 50/60Hz



**⚠ Please read "Safety Considerations" in operation manual before using.**



### ■ Ordering Information

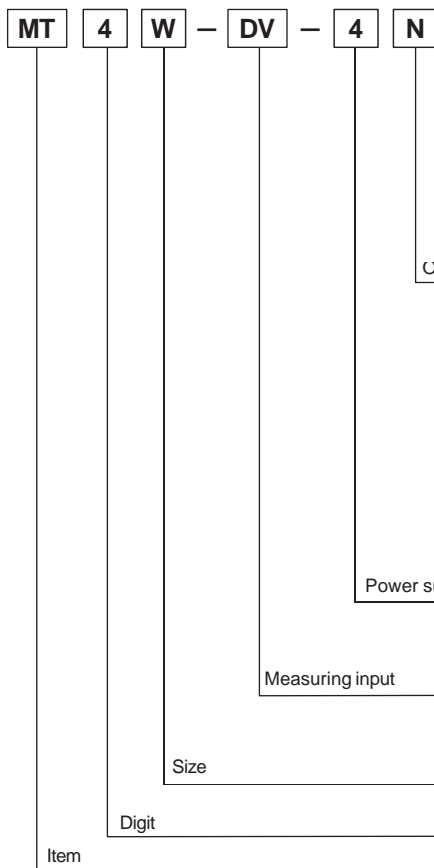

100-240VAC	N	Indicator (without output function)
	0	Relay output
	1	NPN open collector output
	2	PNP open collector output
	3 <sup>※1</sup>	Relay (low out)+transmission (DC4-20mA) output
	4 <sup>※1</sup>	Relay (low out)+RS485 communication output
	5	BCD dynamic output
12-24VDC, 100-240VAC	N	Indication type (no output function)
	0	Relay+transmission (DC4-20mA) output
	1	Relay output
	2	NPN open collector+BCD dynamic output
	3	PNP open collector+BCD dynamic output
	4	NPN open collector+transmission (DC4-20mA) output
	5	PNP open collector+transmission (DC4-20mA) output
100-240VAC	6	NPN open collector+low speed serial output
	7	PNP open collector+low speed serial output
	8	NPN open collector+RS485 communication output
	9	PNP open collector+RS485 communication output
	1 <sup>※2</sup>	12-24VDC
	4	100-240VAC 50/60Hz
	DV	DC voltage
DA	DC current	
AV	AC voltage	
AA	AC current	
Y	DIN W72×H36mm	
W	DIN W96×H48mm	
4	9999 (4-digit)	
MT	Multi meter	

※1: Only IST(preset output mode) setting is available in MT4Y-□-43 (relay (low out)+transmission (DC4-20mA) output) and MT4Y-□-43 (relay (low out)+transmission (DC4-20mA) output) models.

※2: Only for MT4W.


※To measure the current over DC5A, please select DV type because the shunt should be used.

※In case of selecting frequency display, no output will be provided even if it is output support models. (main output, sub output and RS485 communication output)

- (A) Photoelectric Sensors
- (B) Fiber Optic Sensors
- (C) Door/Area Sensors
- (D) Proximity Sensors
- (E) Pressure Sensors
- (F) Rotary Encoders
- (G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
- (H) Temperature Controllers
- (I) SSRs / Power Controllers
- (J) Counters
- (K) Timers
- (L) Panel Meters
- (M) Tacho / Speed / Pulse Meters
- (N) Display Units
- (O) Sensor Controllers
- (P) Switching Mode Power Supplies
- (Q) Stepper Motors & Drivers & Controllers
- (R) Graphic/ Logic Panels
- (S) Field Network Devices
- (T) Software

# MT4Y/MT4W Series

## Specifications

Series	MT4Y-DV-4□ MT4Y-DA-4□	MT4Y-AV-4□ MT4Y-AA-4□	MT4W-DV-4□ MT4W-DA-4□	MT4W-AV-4□ MT4W-AA-4□	MT4W-DV-1□ MT4W-DA-1□	MT4W-AV-1□ MT4W-AA-1□
Measurement input	DC voltage, current	AC voltage, current, Frequency	DC voltage, current	AC voltage, current, Frequency	DC voltage, current	AC voltage, current, Frequency
Power supply	100-240VAC□ 50/60Hz				12-24VDC□	
Allowable voltage range	90 to 110%					90 to 110%
Power consumption	5VA				5W	
Display method	7-segment LED display (red) (character height: 14.2mm)					
Display accuracy	• 23°C±5°C – DC Type: F.S. ±0.1% rdg±2-digit / AC Type: F.S. ±0.3% rdg±3-digit (frequency: F.S.±0.1% rdg±2-digit) DC/AC Type: F.S. +0.3% rdg ±3-digit max. only for 5A terminal • -10°C to 50°C – DC/AC Type: F.S.±0.5% rdg±3-digit					
Max. allowable input	110% F.S. for each measured input range					
A/D conversion method	Practical oversampling using successive approximation ADC					
Sampling cycle	DC type: 50ms, AC type: 16.6ms					
Max. display range	-1999 to 9999 (4-digit)					
Preset output	• Relay output - Contact capacity: 250VAC□ 3A, 30VDC□ 3A / Contact composition: N.O (1a) • NPN/PNP Open collector output - Max. 12-24VDC□ ±2V 50mA (resistive load)					
Sub output (transmission output)	• RS485 communication output - Baud rate: 1,200/2,400/4,800/9,600, Communication method : 2-wire half duplex, Synchronous method: Asynchronous method, Protocol: Modbus type • Serial/BCD dynamic output - NPN Open collector output: 12-24VDC Max. 50mA (resistive load) • DC4-20mA output - Resolution: 12,000 division (load resistance max. 600Ω), Response time: max. 450ms					
AC measuring function※1	Selectable RMS or AVG					
Frequency measurement function※1	Measurement range: 0.100 to 9999Hz (variable by decimal point position)					
Hold function※2	Includes (external hold function)					
Insulation resistance	Over 100MΩ (at 500VDC megger, between external terminal and case)					
Dielectric strength	2000VAC 50/60Hz for 1 min (between external terminal and case)					
Noise immunity	±2kV the square wave noise (pulse width: 1μs) by the noise simulator					
Vibration	Mechanical	0.75mm amplitude at frequency of 10 to 55Hz (for 1 min) in each X, Y, Z direction for 2 hours				
	Malfunction	0.5mm amplitude at frequency of 10 to 55Hz (for 1 min) in each X, Y, Z direction for 10 min				
Shock	Mechanical	100m/s <sup>2</sup> (approx. 10G) in each X, Y, Z direction for 3 times				
	Malfunction	300m/s <sup>2</sup> (approx. 30G) in each X, Y, Z direction for 3 times				
Relay life cycle	Malfunction	Min. 20,000,000 operations				
	Mechanical	Min. 100,000 operations (250VAC 3A load current)				
Environment	Ambient temperature	-10 to 50°C, storage: -20 to 60°C				
	Ambient humidity	35 to 85%RH, storage: 35 to 85%RH				
Insulation type	Double insulation or reinforced insulation (mark: □, dielectric strength between the measuring input part and the power part: 1kV)					
Approval	CE  us				CE	
Weight※3	Approx. 213.5g (approx. 134g)			Approx. 326g (approx. 211g)		

※1: AC measuring function, and frequency measuring function are only for AC measuring input type.

※2: MT4Y-□-4N model has no hold function.

※3: The weight includes packaging. The weight in parenthesis is for unit only.

※Environment resistance is rated at no freezing or condensation.

## Unit Description




### MT4Y Series



1. HI: High output indication of preset
2. GO: GO output indication of preset
3. LO: Low output indication of preset

### MT4W Series



4.  key: mode key
5.  key: moves digit, enters parameter mode,  key: changes vs
6. unit label part


※There is no 1, 2, 3 on a display panel of MT4Y-□-4N, 45, 46 and MT4W-□-4N.

※In MT4Y-□-□3, □4, OUT is used for Go output display and there is no 1, 3 in display panel.


## ■ Connections

### ⊙ Measuring input connection of MT4Y Series


#### ● MT4Y-DV-4




#### ● MT4Y-AV-4



#### ● MT4Y-DA-4




#### ● MT4Y-AA-4




### ⊙ Output terminal of connection of MT4Y Series

#### ● MT4Y-□-4N (indicator)




#### ● MT4Y-□-40 (triple relay output)

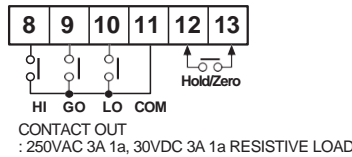


#### ● MT4Y-□-41

(triple NPN open collector output)




#### ● MT4Y-□-42

(triple PNP open collector output)




#### ● MT4Y-□-43

(relay+transmission (DC4-20mA) output)


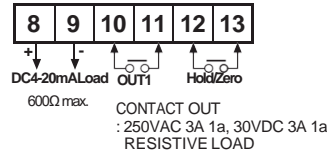


#### ● MT4Y-□-44

(relay+RS485 communication output)

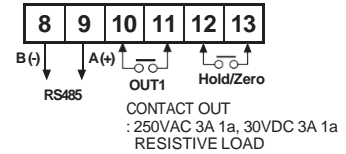

#### ● MT4Y-□-45 (BCD dynamic output)

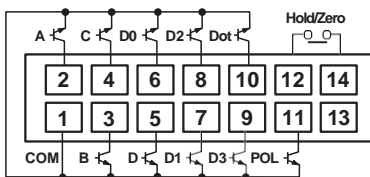


※Hirose connector pin header model of the unit: HIF3BA-14PA-2.54DS

※Contact Hirose Electric to purchase socket and wires of Hirose connector.

[Socket: HIF3BA-14D-2.54R]


#### ● MT4Y-□-46 (low speed serial output)




※POL: When a display value is "-", the signal of "-" will be outputted.

### ⊙ Measuring input connection of MT4W Series


#### ● MT4W-DV-□□

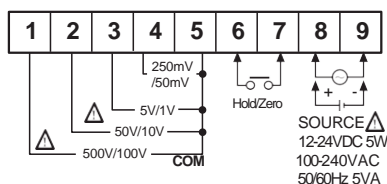


#### ● MT4W-AV-□□

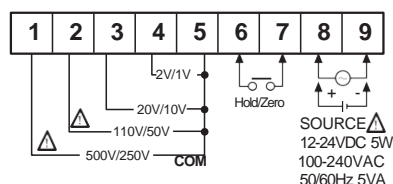

#### ● MT4W-DA-□□

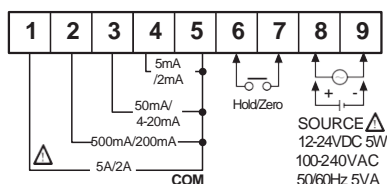

#### ● MT4W-AA-□□

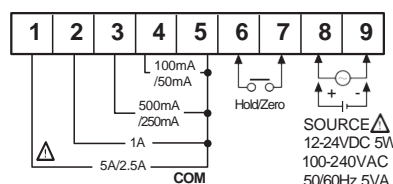

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers

(R) Graphic/ Logic Panels





(S) Field Network Devices

(T) Software

# MT4Y/MT4W Series



## ◎ Output terminal connection of MT4W Series

- **MT4W-□□0** (triple relay+transmission (DC4-20mA) output)
- **MT4W-□□1** (triple relay output)

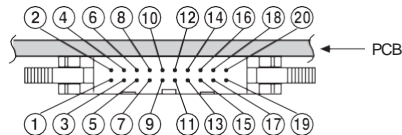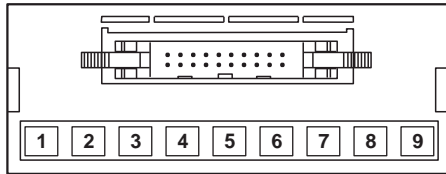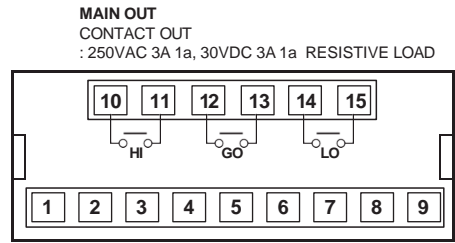
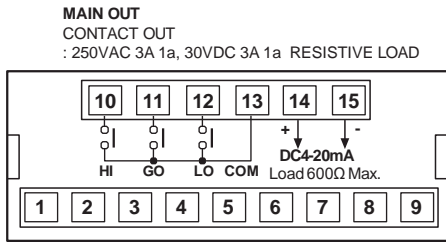


※Hirose connector pin header model of the unit: HIF3BA-20PA-2.54DS  
※Contact Hirose Electric to purchase socket and wires of Hirose connector.  
[Socket: HIF3BA-20D-2.54R]



- **MT4W-□□2 / MT4W-□□3** (triple NPN/PNP open collector+BCD dynamic output)

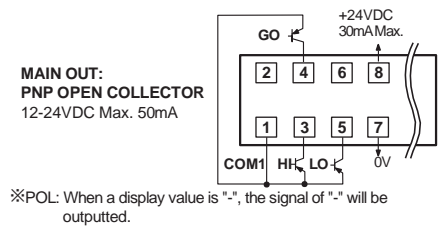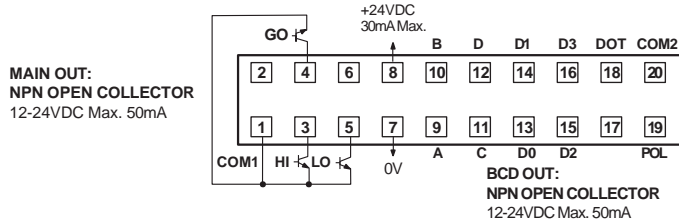



- **MT4W-□□4 / MT4W-□□5** (triple NPN/PNP open collector+transmission (DC4-20mA) output)

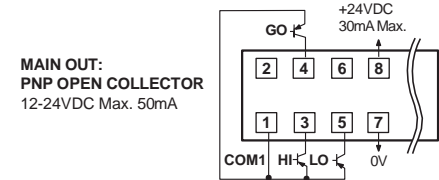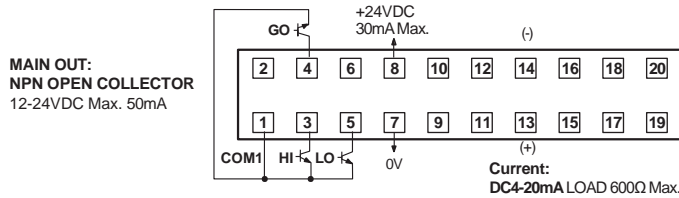

- **MT4W-□□6 / MT4W-□□7** (triple NPN/PNP open collector+low speed serial output)

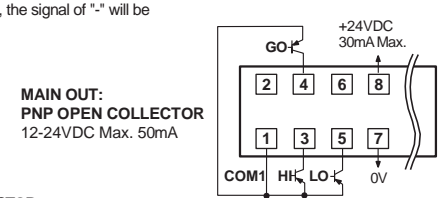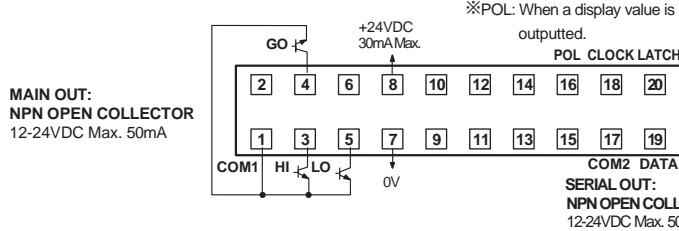



- **MT4W-□□8 / MT4W-□□9** (triple NPN/PNP open collector+RS485 communication output)

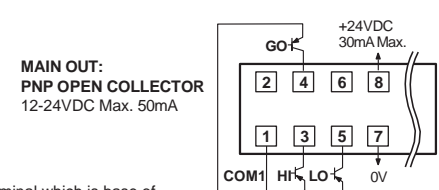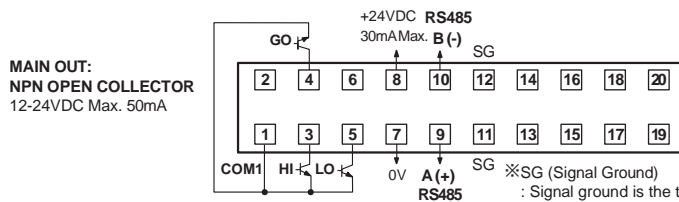

## ■ Dimensions


(unit: mm)

### ● MT4Y-□-4N, 45, 46

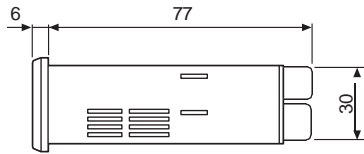


<MT4Y-□-4N, 40 to 44, 46>

### ● Panel cut-out



### ● MT4Y-□-43, 44


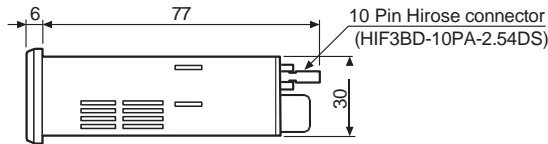


<MT4Y-□-45>

### ● MT4Y-□-40, 41, 42




### ● MT4W-□-□N (indicator)

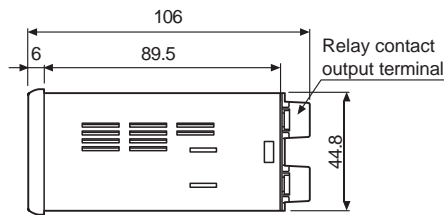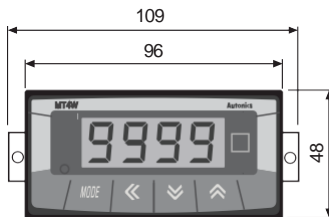


※There is no Relay output terminal block in indication type.

< MT4W-□-□N, MT4W-□-□0, □1 >

### ● Panel cut-out

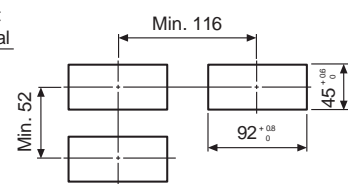


### ● MT4W-□-□0 to □9

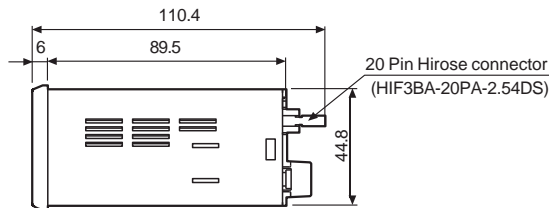

< MT4W-□-□2 to □9 >

## ■ Parameter Setting

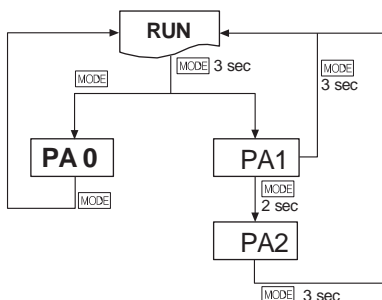


- ※Press **[MODE]** key in **RUN** mode and it enters **PA 0** group.
- ※Press **[MODE]** key for over 3 sec in **RUN** mode, it displays **[PA1]**.
- ※Press **[MODE]** key for over 5 sec in **RUN** mode, it displays **[PA2]** after **[PA1]**. When pressing **[MODE]** key continually, it stops displaying at **[PA2]**.
- ※It is advanced to current display parameter releasing **[MODE]** key at **[PA1]** or **[PA2]**.
- ※Press **[MODE]** key for over 3 sec in any parameter groups, it returns to **RUN** mode.
- ※If any key is not entered for 60 sec in each parameter, it returns to **RUN** mode.
- ※After returning to **RUN** mode, press **[MODE]** key within 2 sec, it returns to previous parameter. (Refer to the below descriptions of each parameter group.)
- ※**PA 0** group cannot be entered when preset output mode of **[PA2]** group is OFF.

(A)	Photoelectric Sensors
(B)	Fiber Optic Sensors
(C)	Door/Area Sensors
(D)	Proximity Sensors
(E)	Pressure Sensors
(F)	Rotary Encoders
(G)	Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
(H)	Temperature Controllers
(I)	SSRs / Power Controllers
(J)	Counters
(K)	Timers
(L)	Panel Meters
(M)	Tacho / Speed / Pulse Meters
(N)	Display Units
(O)	Sensor Controllers
(P)	Switching Mode Power Supplies
(Q)	Stepper Motors & Drivers & Controllers
(R)	Graphic/ Logic Panels
(S)	Field Network Devices
(T)	Software

# MT4Y/MT4W Series

## Parameter 1 Group

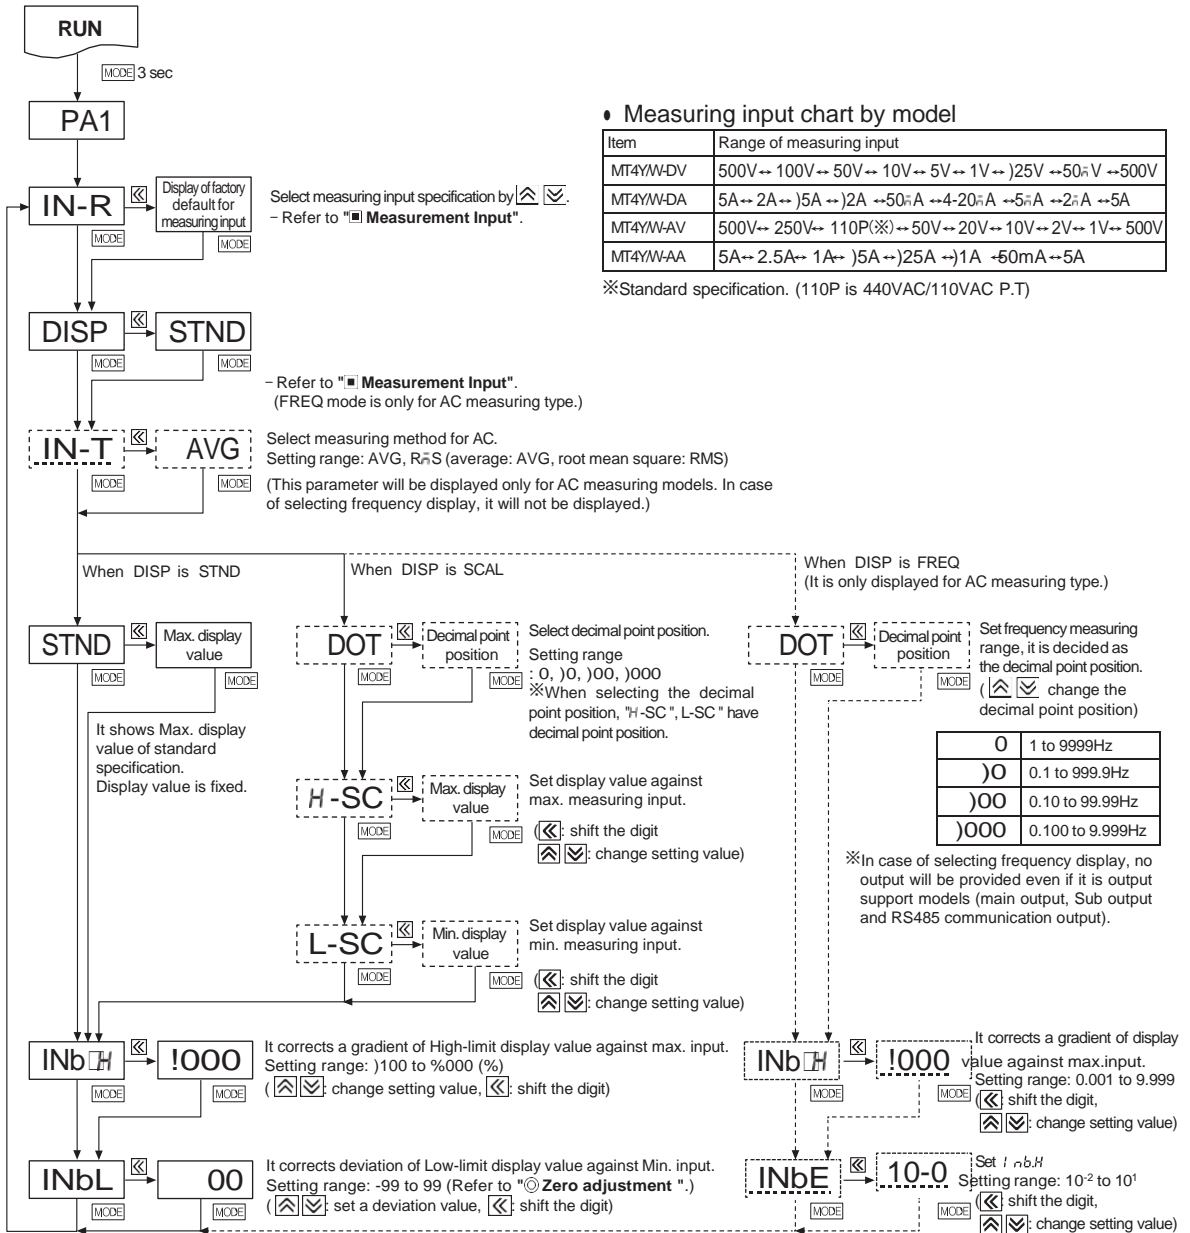


※After setting each mode, press **MODE** key for 2 sec to return to **RUN**.

※If any key is untouched for 60 sec after advance to parameter, it will return to **RUN**.

## Factory defaults

Parameter	MT4Y/W-DV	MT4Y/W-DA	MT4Y/W-AV	MT4Y/W-AA	Parameter	MT4Y/W-DV	MT4Y/W-DA	MT4Y/W-AV	MT4Y/W-AA
IN-R	500V	SA	500V	SA	INb <sub>H</sub>	!000	!000	!000	!000
DISP	STND	STND	STND	STND	INb <sub>L</sub>	00	00	00	00
IN-T	—	—	AVG	AVG	DOT	)0	)000	)0	)000
STND	5)0	%000	5)0	%000	INb <sub>E</sub>	—	—	10-0	10-0

## Parameter 2 Group

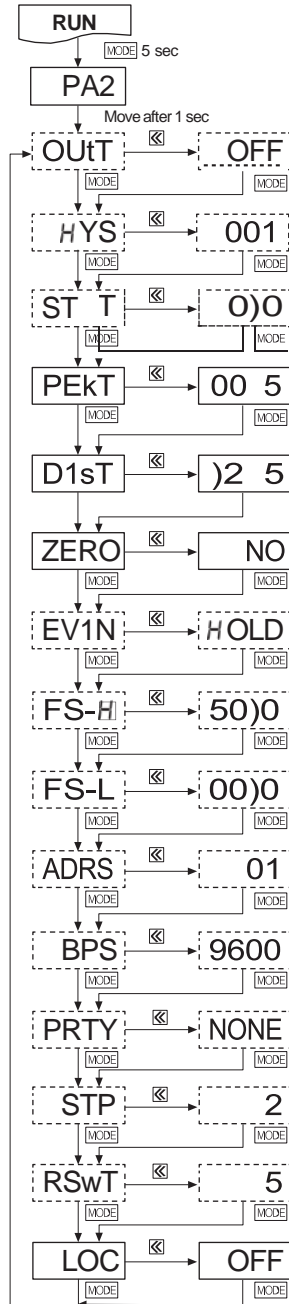

Select preset output mode. (only for available models)  
Setting range: OFF, IST, hST, LhST, HhST, LIST, LdST  
※Only IST setting is available in MT4Y-□-43 and MT4Y-□-44 models.

Set preset hysteresis. The range is within 10% of max. display range (unit: digit).  
※ OUT mode is OFF, it is not displayed.

Set startup compensation time.  
( $\leftarrow$ ): shift the digit,  $\wedge$   $\vee$ : change setting value)  
Setting range: 0.0 to 99.9 sec

When initially supplying power, delays monitoring of high-limit/low-limit value of display value for the set time.  
( $\leftarrow$ ): shift the digit,  $\wedge$   $\vee$ : change setting value)

Setting range: 00 to 30 sec

※If it is set to 00 sec [00 S], parameters of high-peak monitoring value [hPEK]/low-limit monitoring value [lPEK] in the parameter 0 group will be not displayed.

Set display cycle and also variable sets by 0.1 sec. ( $\leftarrow$ ): shift the digit,  $\wedge$   $\vee$ : change setting value)  
Setting range: 0.1 to 5.0 sec

Select zero function with operation at front. (set with  $\wedge$   $\vee$  key)

When  $\leftarrow$  +  $\wedge$  Key are pressed for 3 sec to set YES, it will be zero function and the deviation value is saved automatically at INbL mode.

Select input with 6, 7 (MT4W)[12, 13 (MT4Y)] terminal or zero function for external signal.  
(set with  $\wedge$   $\vee$  Key)

hOLD: Holding display value, ZERO: Zero function using Hold/Zero terminal

Set the high limit value, output point of current output 20mA.

( $\leftarrow$ ): shift the digit,  $\wedge$   $\vee$ : change setting value)  
(When changing measuring input and prescale mode, it is changed automatically as maximum value of input range.)

Set the low limit value, output point of current output 4mA.

( $\leftarrow$ ): shift the digit,  $\wedge$   $\vee$ : change setting value)  
(When changing measuring input and prescale mode, it is changed automatically as minimum value of input range.)

Set the address of RS485 communication output.

( $\leftarrow$ ): shift the digit,  $\wedge$   $\vee$ : change setting value)  
Setting range: 01 to 99

Select Baud rate of RS485 communication output.

Setting range: 9600, 4800, 2400, 1200

Set parity bit of RS485 communication.

Setting range: NONE, EVEN, ODD

Set stop bit of RS485 communication.

Setting range: 1, 2

Set response wait time of RS485 communication.

Setting range: 5 to 99

Set key lock function and select from 4 types.

Setting range: OFF, LOC1, LOC2, LOC3

OFF	Disable to lock keys
LOC1	Lock Parameter 1
LOC2	Lock Parameter 1, 2
LOC3	Lock Parameter 0, 1 and 2

※The dotted mode is only displayed for output type.

※After setting each mode, press [MODE] key for 2 sec to return to RUN mode.

※If any key is untouched for 60 sec after advance to parameter, it will return to RUN mode.

### Factory defaults

Parameter	MT4Y/W-DV	MT4Y/W-DA	MT4Y/W-AV	MT4Y/W-AA	Parameter	MT4Y/W-DV	MT4Y/W-DA	MT4Y/W-AV	MT4Y/W-AA
OUT	OFF	OFF	OFF	OFF	EV1N	HOLD	HOLD	HOLD	HOLD
HYS	001	001	001	001	FS-H	50)0	%000	50)0	%000
STAT	0)0	0)0	0)0	0)0	FS-L	00)0	)000	00)0	)000
PEK T	00 5	00 5	00 5	00 5	ARDS	01	01	01	01
D1sT	)2 5	)2 5	)2 5	)2 5	BPS	9600	9600	9600	9600
ZERO	NO	NO	NO	NO	LOC	OFF	OFF	OFF	OFF

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers


(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software

# MT4Y/MT4W Series

## Parameter 0 Group

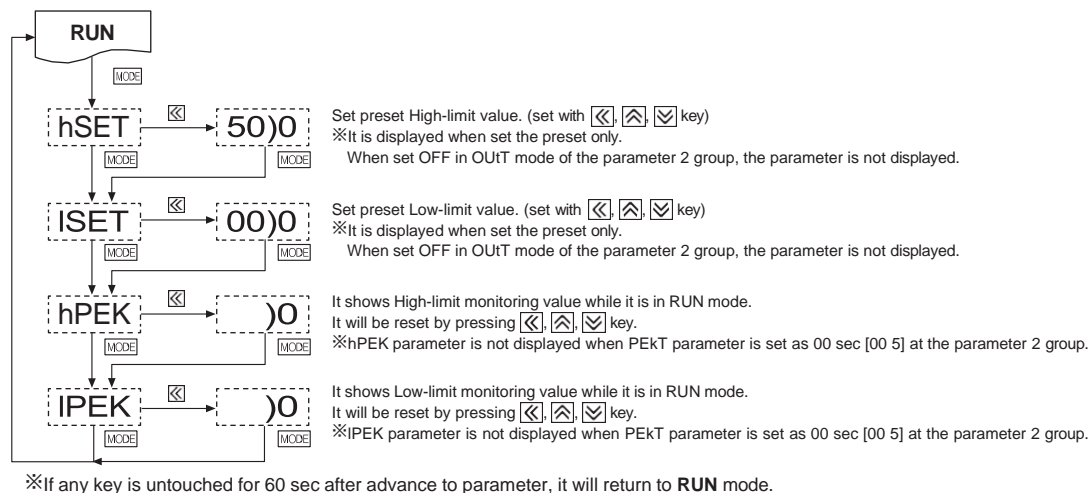

## Factory defaults

Parameter	MT4Y/W-DV	MT4Y/W-DA	MT4Y/W-AV	MT4Y/W-AA	Parameter	MT4Y/W-DV	MT4Y/W-DA	MT4Y/W-AV	MT4Y/W-AA
hSET	50)0	%000	50)0	%000	hPEK	)0	)000	)0	)000
ISET	00)0	)000	00)0	)000	IPEK	)0	)000	)0	)000

## Measurement Input

Type	Measuring input and range	Input impedance	Display range [STND]	Prescale display range [SCAL]										
DC voltage	0-500V [500V]	4.33M $\Omega$	0.0 to 500.0 (fixed)	<table border="1"> <thead> <tr> <th>DOT</th> <th>Display range</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>-1999 to 9999</td> </tr> <tr> <td>)0</td> <td>-199.9 to 999.9</td> </tr> <tr> <td>)00</td> <td>-19.99 to 99.99</td> </tr> <tr> <td>)000</td> <td>-1.999 to 9.999</td> </tr> </tbody> </table> <p>(Display range is variable according to decimal point position.)</p> <p>※Please wire the proper terminal to its max. input within 30 to 100% of the input terminal. When it is higher than input, it may cause terminal breakdown and HHHH appears. The accuracy is decreased when it is connected to the terminal under 30%.</p> <p>※In case of 0 to 110V [110P] of AC voltage range and using P.T (potential transformer) for 440V/110VAC, if 110V is input, and the unit displays 440V automatically by preset scale value for P.T user's convenient.</p>	DOT	Display range	0	-1999 to 9999	)0	-199.9 to 999.9	)00	-19.99 to 99.99	)000	-1.999 to 9.999
	DOT	Display range												
	0	-1999 to 9999												
	)0	-199.9 to 999.9												
	)00	-19.99 to 99.99												
	)000	-1.999 to 9.999												
	0-100V [100V]	4.33M $\Omega$	0.0 to 100.0 (fixed)											
0-50V [50V]	433.15k $\Omega$	0.00 to 50.00 (fixed)												
0-10V [10V]	433.15k $\Omega$	0.00 to 10.00 (fixed)												
0-5V [5V]	43.15k $\Omega$	0.000 to 5.000 (fixed)												
0-1V [1V]	4.315k $\Omega$	0.000 to 1.000 (fixed)												
0-250mV [25V]	2.15k $\Omega$	0.0 to 250.0 (fixed)												
0-50mV [50 $\bar{V}$ ]	2.15k $\Omega$	0.00 to 50.00 (fixed)												
DC current	0-5A [5A]	0.01 $\Omega$	0.000 to 5.000 (fixed)											
	0-2A [2A]	0.01 $\Omega$	0.000 to 2.000 (fixed)											
	0-500mA [5A]	0.1 $\Omega$	0.0 to 500.0 (fixed)											
	0-200mA [2A]	0.1 $\Omega$	0.0 to 200.0 (fixed)											
	0-50mA [50 $\bar{A}$ ]	1.0 $\Omega$	0.00 to 50.00 (fixed)											
	4-20mA [4-20]	1.0 $\Omega$	4.00 to 20.00 (fixed)											
	0-5mA [5 $\bar{A}$ ]	10.0 $\Omega$	0.000 to 5.000 (fixed)											
	0-2mA [2 $\bar{A}$ ]	10.0 $\Omega$	0.000 to 2.000 (fixed)											
AC voltage	0-500V [500V]	4.98M $\Omega$	0.0 to 500.0 (fixed)											
	0-250V [250V]	4.98M $\Omega$	0.0 to 250.0 (fixed)											
	0-110V [110P]	1.08M $\Omega$	0.0 to 440.0 (fixed)											
	0-50V [50V]	1.08M $\Omega$	0.00 to 50.00 (fixed)											
	0-20V [20V]	200k $\Omega$	0.00 to 20.00 (fixed)											
	0-10V [10V]	200k $\Omega$	0.00 to 10.00 (fixed)											
	0-2V [2V]	20k $\Omega$	0.000 to 2.000 (fixed)											
	0-1V [1V]	20k $\Omega$	0.000 to 1.000 (fixed)											
AC current	0-5A [5A]	0.01 $\Omega$	0.000 to 5.000 (fixed)											
	0-2.5A [2.5A]	0.01 $\Omega$	0.000 to 2.500 (fixed)											
	0-1A [1A]	0.05 $\Omega$	0.000 to 1.000 (fixed)											
	0-500mA [5A]	0.1 $\Omega$	0.0 to 500.0 (fixed)											
	0-250mA [25A]	0.1 $\Omega$	0.0 to 250.0 (fixed)											
	0-100mA [1A]	0.5 $\Omega$	0.0 to 100.0 (fixed)											
	0-50mA [50 $\bar{A}$ ]	0.5 $\Omega$	0.00 to 50.00 (fixed)											



## ■ Sold Separately

### ◎ Communication converter

- **SCM-WF48**  
(Wi-Fi to RS485-USB wireless communication converter)



- **SCM-US48I**  
(USB to RS485 converter)



- **SCM-38I**  
(RS232C to RS485 converter)



### ◎ Display Units (DS/DA-T Series)

- **DS/DA-T Series**  
(RS485 communication input type display unit)



DS16-□T



DS22/DA22-□T



DS40/DA40-□T



DS60/DA60-□T

※Connect RS485 communication input type display unit (DS/DA-T Series) and RS485 communication output model of MT4Y/MT4W Series, the display unit displays present value of the device without PC/PLC.

## ■ Functions

### ◎ AC frequency measurement

#### [PA 1 group: DISP]

It measures input signal frequency when it is AC input. It uses fixed decimal point [PA1: DOT], measured range can be changed by setting and measured range of decimal point position is as below chart. It is available to adjust the upper gradient at [PA 1: INb  $\bar{H}$ ] and [PA 1: INbE]. In order to measure frequency normally, input signal, over 10% F.S. of the measured range, should be supplied. Please select the proper point of

#### ① Measuring range

Decimal point position	0.000	0.00	0.0	0
Measurement range	0.100 to 9.999Hz	0.10 to 99.99Hz	0.1 to 999.9Hz	1 to 9999Hz

※Accuracy of frequency measurement:

Below 1kHz, F.S.  $\pm 0.1$ rdg  $\pm 2$ -digit.

From 1kHz to 10kHz, F.S.  $\pm 0.3$ rdg  $\pm 2$ -digit.

② INb  $\bar{H}$ : 0.100 to 9.999 [Gradient adjustment of high value]

③ INbE:  $10^{-2}$ ,  $10^{-1}$ ,  $10^0$ ,  $10^1$  [Index adjustment of INb  $\bar{H}$ ]

### ◎ Zero adjustment

#### [Deviation correction function of low limit display value]

It adjusts the display value of the optional configured input value as zero by force, zero point error can be adjusted with 3 ways as below. When zero point adjustment with front key and Hold terminal is finished normally, zero point of measurement terminal is displayed and the adjusted value at saved in INbL automatically.

Operation	Input correction value	Front panel key	Input external signal
Description	PA 1: Direct input correction value method at INbL.	Press $\bar{L}$ , $\bar{H}$ key for 3 sec at the RUN mode.	Short-circuit external Hold terminal 11,12 [6, 7 (MT4W)] over min. 50m.

※Refer to "◎ Error correction", "◎ Error display" and "■ Parameter 2 Group" for function and error.


### ◎ Transmission (DC4-20mA) output scale [PA2 group: FS-H / FS-L]

It sets transmission output for the display value at the output current DC4-20mA.

It sets display value for 4mA at FS-L and 20mA at FS- $\bar{H}$  and the range between FS- $\bar{H}$  and FS-L should be 10%

※When min. set interval between FS- $\bar{H}$  and FS-L is set as under 10% F.S., it changed as over 10% F.S. automatically.

※Preset display value is fixed to output as 4mA at under FS-L and 20mA at over FS- $\bar{H}$ .

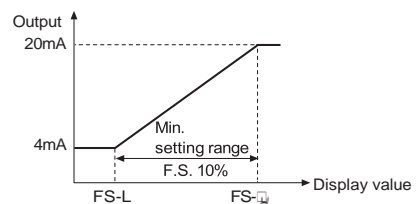

(A)	Photoelectric Sensors
(B)	Fiber Optic Sensors
(C)	Door/Area Sensors
(D)	Proximity Sensors
(E)	Pressure Sensors
(F)	Rotary Encoders
(G)	Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
(H)	Temperature Controllers
(I)	SSRs / Power Controllers
(J)	Counters
(K)	Timers
(L)	Panel Meters
(M)	Tacho / Speed / Pulse Meters
(N)	Display Units
(O)	Sensor Controllers
(P)	Switching Mode Power Supplies
(Q)	Stepper Motors & Drivers & Controllers
(R)	Graphic/ Logic Panels
(S)	Field Network Devices
(T)	Software

# MT4Y/MT4W Series

## Initialization

It initializes as the factory default status. If press  $\left[ \leftarrow \right]$ ,  $\left[ \rightarrow \right]$ ,  $\left[ \checkmark \right]$  keys together for 2 sec in **RUN** mode, **INIT** mode and the setting value (NO) is displayed every 0.5 sec and it will be initialized as the factory default when press  $\left[ \text{MODE} \right]$  key after change NO  $\rightarrow$  YES.

## Startup compensation time [PA 2 group: STAT]

This time function limits the operation of an output until the measured input (overvoltage or inrush current) is stable at moment of power on. All outputs are off during startup compensation time setting after power is applied. Setting range: 00.0 to 99.9 (unit: sec) Factory default: 00.0

## Error display

Display	Description
HHHH	Flashes when measuring input is exceeded the max. allowable input (110%)
LLLL	Flashes when measuring input is exceeded the max. allowable input (-10%)
D-HH	Flashes when display input is exceeded the max. display range (9999)
D-LL	Flashes when display input is exceeded the min. display range (-1999)
F-HH	Flashes when measuring frequency is exceeded the max. measuring value (9999)
OVER	Flashes when it exceeds zero adjustment range ( $\pm 99$ )


※ Error display is released automatically when it is in the measured and display range.

※ "LLLL" is displayed when the measuring input is DC4-20mA.

※ After flashing "OVER" 2 times when it exceeds the zero adjustment range, it returns to RUN mode.


## Display scale [PA 1 group: H-SC/L-SC]

This function is to display setting (-1999 to 9999) of particular High/Low-limit value in order to display High/Low-limit value of measured input. If measured inputs are 'a' and 'b' and particular values are 'A' and 'B', it will display a=A, b=B as below graphs.

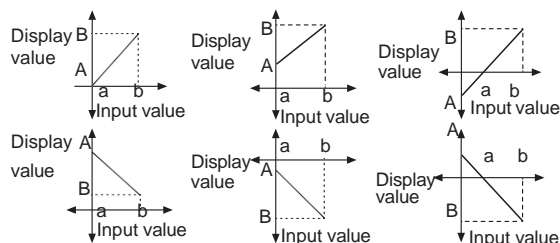

## Gradient correction [PA 1 group: INbH]

This function is to correct a gradient of prescale value and display value. (Fig. 1) Display value Y can be used as  $\alpha$ ,  $\beta$  times against X input value by correction function  $[INbH]$ . And also can be used as correction function of max. display value (H-SC). Adjustment range is 0.100 to 5.000 and multiply current gradient. E.g.) Input: DC200mV, Display: 3.000 for MT4W-DV

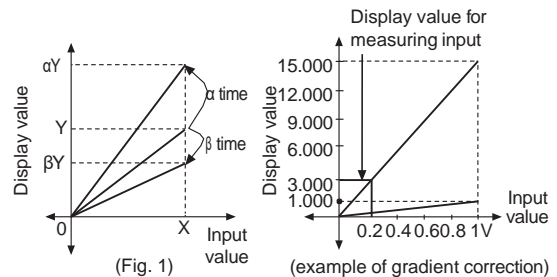

- Select 0-1VDC[1V] for measuring input in Parameter1.
- Standard specification in input: 0-1VDC and 1.000 therefore it has to be 15.000 (H-SC) for 1VDC (input) in order to display 3.000 for DC200mV (input). But it is disable due to setting range is 9.999
- In this case, please check below chart. Please set as  $INbH \times H-SC=15.000$

Setting	H-SC	L-SC	INbH	Other
①	Disable	0.000	1.000	—
②	7.500	0.000	2.000	In this case, any setting methods display the same display value.
③	5.000	0.000	3.000	
④	3.750	0.000	4.000	
⑤	3.000	0.000	5.000	

## Error correction [PA 1 group: INbL / INbL]

It corrects display value error of measured input.  $INbL: \pm 99$  [Adjust deviation of low value]  $INbH: 5.000$  to  $0.100$  [Correct gradient (%) of high value]  $Display\ value = (measured\ value \times INbH) + INbL$  E.g.) When the measured range is 0 to 500V, and the display range is 0 to 500.0. If the low display value is "1.2" to 0V input, set -12 as  $INbL$  value to display "0" by adjusting offset of the low value. The display value to 500V measured input varies by adjusting the offset of low value. If this display value is "501.0", calculate  $500.0/501.0$  (desired display value/the display value), and set the 0.998 correction value as the  $INbH$  to display 500.0 by adjusting gradient of high value. ※ The offset correction range of  $INbL$  is within -99 to 99 for  $D^0, D^1$  digit regardless of decimal point.

## Display cycle delay [PA 2 group: D1sT]

In some applications the measured input may fluctuate which in turn causes the display to fluctuate. By adjusting the display cycle delay function time in the  $D1sT$  of parameter 2, the operator can adjust the display time within a range of 0.1 sec to 5 sec. For example, if the operator sets the display cycle time to 4.0 sec, the display value displayed will be the average input value over 4 sec and also will show any changes if any every 4 sec.

## Monitoring peak display value

[PA 0 group: hPEK/IPEK, PA 2 group: PEkT ]

It monitors max./min. value of display value based on the current displays value and then displays the data at hPEK, IPEK of parameter 0. Set the delay time (0 to 30 sec) at PEkT of parameter 2 in order to prevent malfunction caused by initial overcurrent or overvoltage, when monitoring the peak value.

Delay time is 0 to 30 sec and it starts to monitor the peak value after the set time. When pressing any one of [←] [→] [↶] [↷] keys at hPEK, IPEK of parameter 0, the monitored data is initialized.

※hPEK, IPEK parameters is not displayed when monitoring delay time [PEkT] of parameter 2 group is set as 00 sec [00 S].

## Preset output operation mode

[PA 2 group: OUTt]

Mode	Output operation	Operation
OFF		No output
IST		If it is equal or smaller than low setting value, LO output will be ON. If it is bigger than low setting value, GO output will be ON.
hST		If it is equal or bigger than high setting value, HI output will be ON. If it is equal or smaller than high setting value, GO output will be ON.
LhST		If it is equal or bigger than low setting value and equal or bigger than high setting value, the output will be ON. If it is bigger than Low setting value and smaller than high setting value, GO output will be ON.
hST		If it is equal or bigger than low set and equal or bigger than high set value, output will be ON. If it is smaller than low setting value and high setting value, GO output will be ON.
LIST		If it is equal or smaller than low setting value, LO output will be ON. If it is equal or smaller than high setting value, HI output will be ON. If it is bigger than low setting value and High setting value, GO output will be ON.
LdST		This operation is the same as IST But it doesn't operate at initial low set value, it will operate at next low set value. If this is higher than low set value, Go output will be ON.

※"H" means hysteresis and able to set 1 to 99 at "HYS" mode in PA 2 among above comparison output chart.  
 ※hSET is displayed according to the setting of output

operation mode, when user sets "OFF", hSET/ ISET are not displayed.

※Only IST setting is available in MT4Y-□-43 and MT4Y-□-44 models.

## Sub output

• RS485 communication output

It is able to set address (01 to 99)

It is able to transmit by selecting modulation speed (transmitted number of signal per 1 sec) of serial transmission. (selectable 1200, 2400, 4800, 9600bps)

• Low-speed serial output

It outputs current display value as Low-frequency (50Hz) type.

• Transmission (DC4-20mA) output

It outputs DC4-20mA against High/Low-limit scale. (resolution: 12000 division)

• BCD dynamic output


It outputs display value as BCD Code.

※Only one sub-output is selectable.


(More than one sub-output is not allowed.)

## Time chart of BCD dynamic output and Serial output

• BCD dynamic output (negative logic)

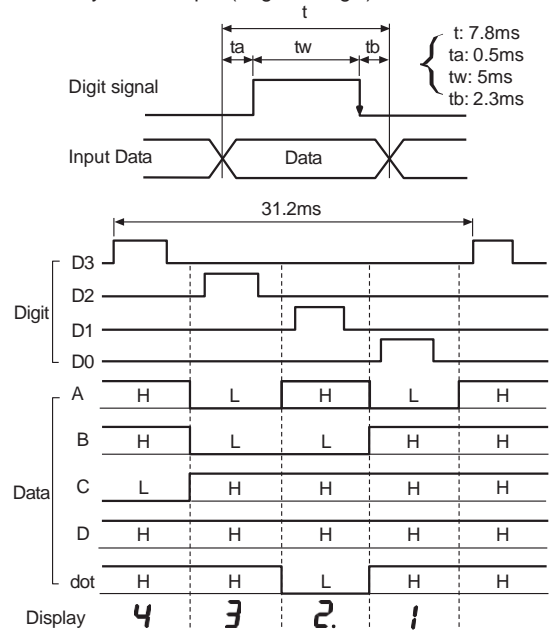

• Serial output (negative logic)-Clock frequency:50Hz

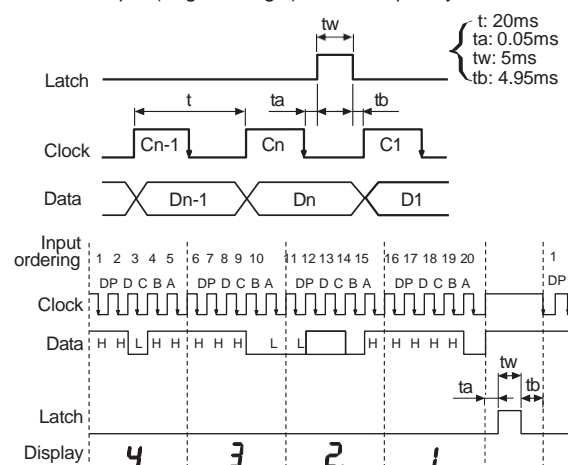

(A) Photoelectric Sensors

(B) Fiber Optic Sensors

(C) Door/Area Sensors

(D) Proximity Sensors

(E) Pressure Sensors

(F) Rotary Encoders

(G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets

(H) Temperature Controllers

(I) SSRs / Power Controllers

(J) Counters

(K) Timers

(L) Panel Meters

(M) Tacho / Speed / Pulse Meters

(N) Display Units

(O) Sensor Controllers

(P) Switching Mode Power Supplies

(Q) Stepper Motors & Drivers & Controllers

(R) Graphic/ Logic Panels

(S) Field Network Devices

(T) Software